



**BLOCH
WIND FARM**

FIGURE 2.12

TYPICAL CABLE TRENCH

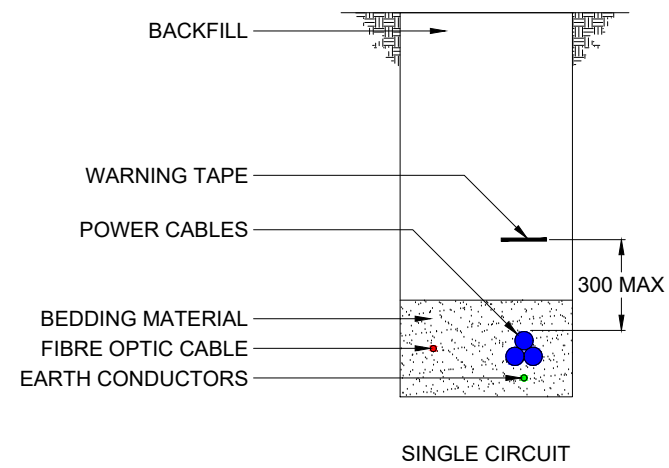

SINGLE CIRCUIT

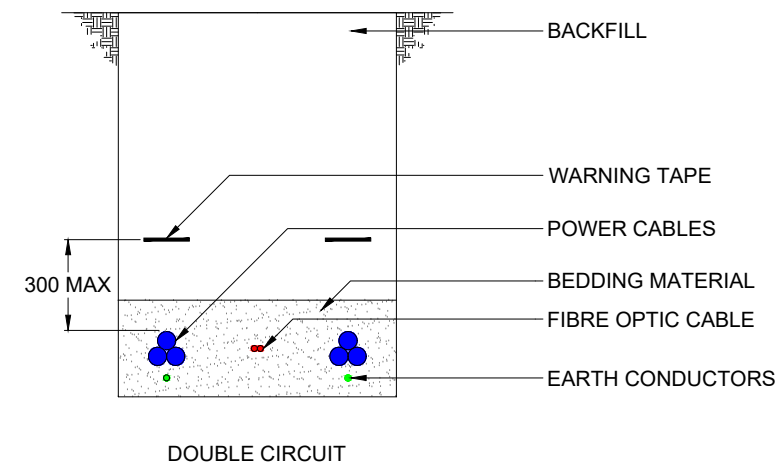


DOUBLE CIRCUIT


TYPICAL CABLE TRENCHES

NOTES

1. THIS DRAWING IS INDICATIVE ONLY AND IS SUBJECT TO CHANGE AT THE DETAILED DESIGN STAGE.
2. ALL DIMENSIONS IN mm.
3. CABLES MAY BE INSTALLED BY CABLE PLOUGH FOR DISTANCES GREATER THAN 1km.

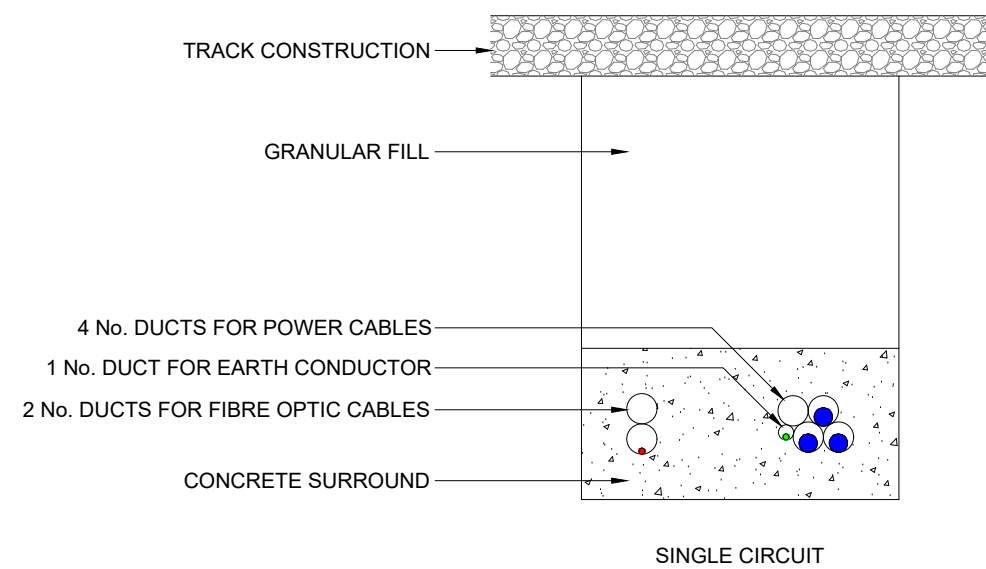

SINGLE CIRCUIT

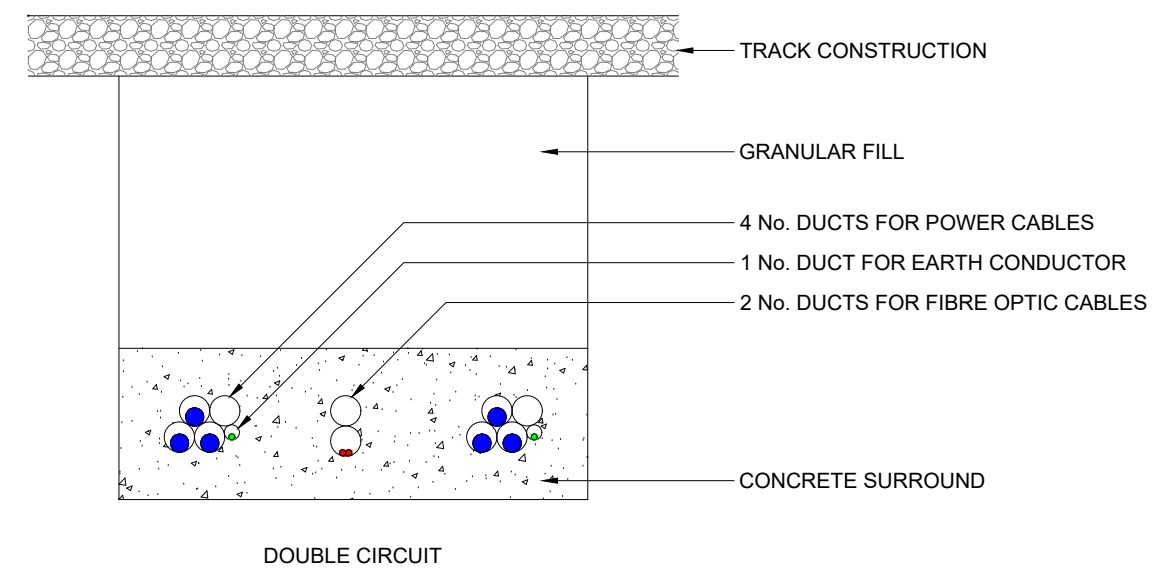

DOUBLE CIRCUIT

TYPICAL TRACK CROSSINGS

LAYOUT DWG	N/A	T-LAYOUT NO.	N/A
------------	-----	--------------	-----

DRAWING NUMBER	04097-RES-CBL-DR-EE-001	REV	01
----------------	-------------------------	-----	----

SCALE - 1:25 @ A3

**ENVIRONMENTAL IMPACT
ASSESSMENT REPORT 2022**

THIS DRAWING IS THE PROPERTY OF RENEWABLE ENERGY SYSTEMS LTD. AND NO REPRODUCTION MAY BE MADE IN WHOLE OR IN PART WITHOUT PERMISSION